
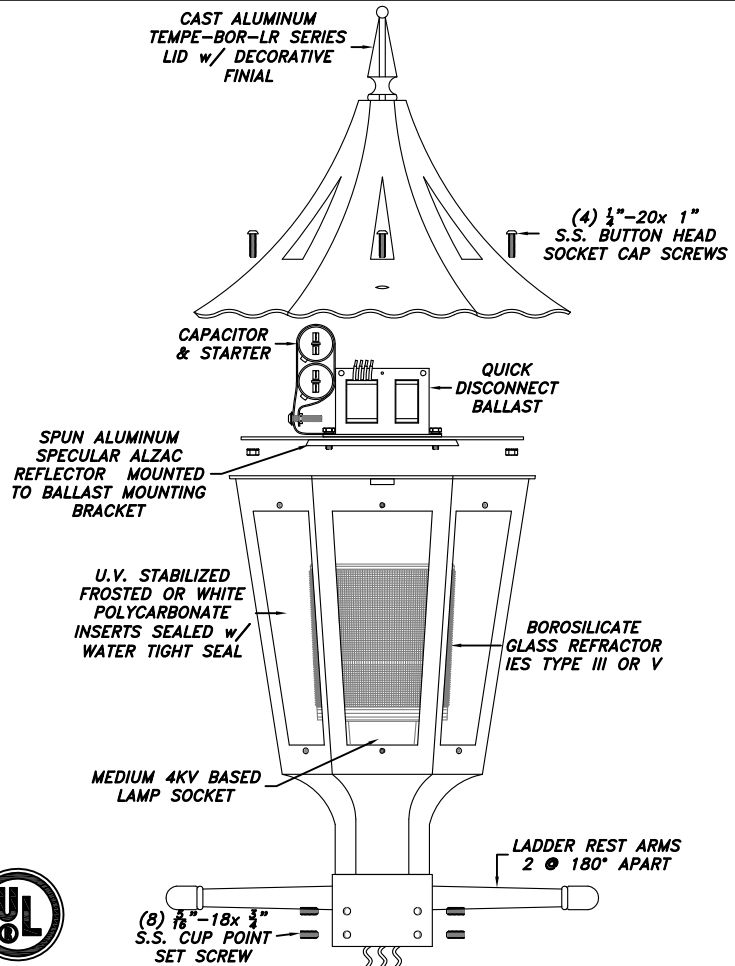


TEMPE SERIES

TEMPE-BOR-LR

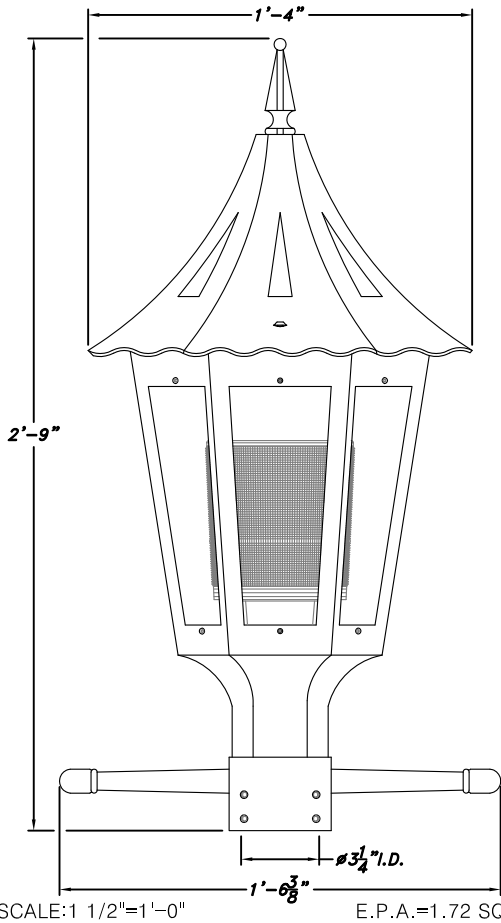

EXAMPLE

TEMPE-BOR-LR-PSMH-150-208-V-BLK

TEMPE-BOR-LR- _____
Series Ballast Wattage Voltage Distribution Color

| LADDER REST | INSERTS | LIGHT SOURCE | WATTAGE | VOLTAGE | LIGHT DISTRIBUTION | COLOR OF POWDER COAT FINISH |
|--|--|-------------------------------|--|---|-----------------------------------|--|
| <input type="checkbox"/> NO LADDER REST (NLR) | <input type="checkbox"/> FROSTED (CLEAR) | <input type="checkbox"/> INC | <input type="checkbox"/> 50w <input type="checkbox"/> 150w | <input type="checkbox"/> 120v | <input type="checkbox"/> TYPE III | <input type="checkbox"/> (BLK) BLACK |
| <input checked="" type="checkbox"/> LADDER REST (LR) | <input type="checkbox"/> WHITE (MILKY) | <input type="checkbox"/> CFL | <input type="checkbox"/> 70w <input type="checkbox"/> 175w | <input type="checkbox"/> 208v | <input type="checkbox"/> TYPE V | <input type="checkbox"/> (HG) HAND BRUSHED GREEN |
| | | <input type="checkbox"/> HPS | <input type="checkbox"/> 100w | <input type="checkbox"/> 240v | | <input type="checkbox"/> (BRZ) BRONZE |
| | | <input type="checkbox"/> PSMH | | <input type="checkbox"/> 277v | | <input type="checkbox"/> (GRN) GREEN |
| | | <input type="checkbox"/> LED | | <input type="checkbox"/> 480v | | <input type="checkbox"/> (HR) HAND BRUSHED GRAY |
| | | | | MULTI TAP 120v 240v 208v 277v PLEASE SPECIFY VOLTAGE | | <input type="checkbox"/> CUSTOM _____ |

LUMINAIRE SPECIFICATION

HOUSING

The post top shall be core cast aluminum. Aluminum shall be certified as pure #356 alloy, free of any porosity, foreign materials or cosmetic fillers. Castings shall be uniform wall thickness with no warping or mold shifting. Minimum wall thickness shall be 3/16". Electrical components are mounted in the ballast canister. The ballast canister shall be mounted in the post top with three stainless steel screws. The refractor will be a borosilicate glass refractor designed for either a type III or type V light distribution pattern.

ELECTRICAL

All electrical components and materials shall be UL-recognized and wired by a certified UL technician. All Niland ballasts are high power factor rated for -30°C/-20°F starting. Medium base sockets are 4 KV rated. The electrical assembly is prewired with quick disconnects for servicing. Fixture shall be UL certified for wet locations.

MOUNTING

Fixture shall be mounted to 3" O.D. x 3" H, tenon with stainless steel allen head set screws (8 @ 90°)

RELAMPING

The fixture's lid is opened by loosening (4) Button Socket Head Cap screw.

FINISH

Fixture finish shall consist of degreasing, phosphate acid etching with 140+ deionized water, rinsed, oven dry off and top coated with a thermoset TGIC super polyester powder coat finish designed not to chalk or fade for many years. All Niland Company powders must pass a minimum 3000-hour salt spray test for corrosion resistance.

CERTIFICATION

The Fixture shall be UL-Listed for wet location use, and all HID listings.

WARRANTY

Fixture shall be warranted to be free of defects for five years. Ballast components shall carry the ballast manufacturers limited warranty of two years.

PHOTOMETRICS

Complete photometric data for all fixtures is available in IES-formatted 3.5 disks. A certified independent laboratory performs all testing. Call the Niland Company directly for more information.

Catalog Name: TEMPE-BOR-LR

Date: 02.15.18

Revision History: N/A

Revision #: 0

Niland Approval: Luis M. Gomez Customer Approval:

Page: 3 of 3



Niland Company

NILAND COMPANY • PH: (915) 779-1405 • FAX: (915) 779-3618 • E-MAIL: INFO@NILANDCO.COM
320 N. Clark El Paso, Tx 79905 • PH: 800-648-9013 • FAX: 888-779-3065 • WEB PAGE: HTTP://www.nilandco.com