
BULL SERIES BULL-SM-1

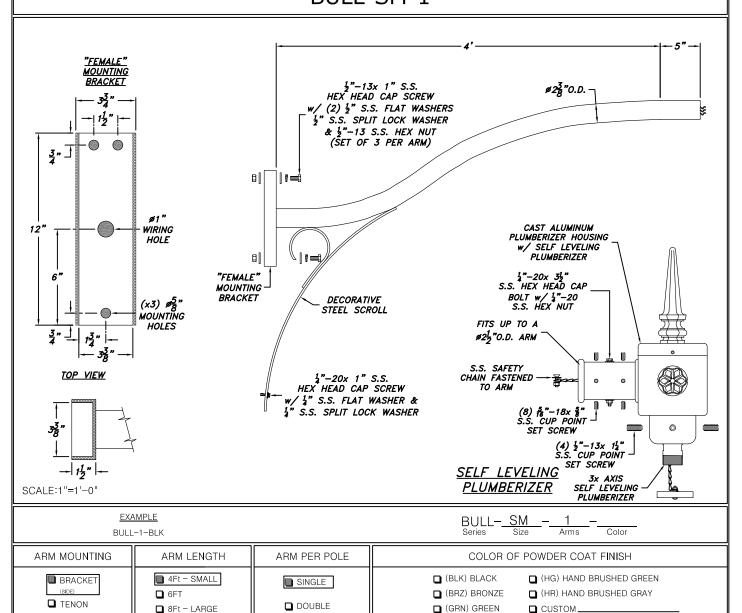

ARM SPECIFICATION

ARM

The arms shall be steel construction. Extrusion shall be 11 guage ($\frac{1}{3}$) wall thickness with no warping or mold shifting. Electrical wiring shall run through arm up and out throught the ≈ 3 " opening.

ELECTRICAL

All electrical wiring is ran through center shaft and arm and shall be UL-recognized and wired by a certified UL technician. The electrical assembly is prewired with quick disconnects for servicing. Fixture shal be UL certified for wet locations.

MOUNTING

Arm shall be mounted to a 3"W.x 12"H.x2" arm bracket using (3) steel hex head set screws for fastening.

FINISH

Fixture finish shall consist of degreasing, phosphate acid etching with 140°+ deionized water, rinsed, oven dry off and top coated with a thermoset TGIC super polyester powder coat finish designed not to chalk or fade for many years. All Niland Company powders must pass a minimum 3000-hour salt spray test for corrosion resistance.

CERTIFICATION

The Fixture shall be UL-Listed for wet location use, and all HID listings.

WARRANTY

Fixture shall be warranted to be free of defects for five years. Ballast components shall carry the ballast manufacturers limited warranty of two years.

Catalog Name: <u>BULL-SM-1</u>	Date: <u>02.15.18</u>
Revision History:N/A	Revision #: <u>0</u>
Niland Approval: Luis M.Gomez Customer Approval:	Page: <u>3</u> of <u>4</u>



Wiland Company

NILAND COMPANY PH: (915) 779-1405 FAX: (915) 779-3618 E-MAIL: INFOGNILANDCO.COM
320 N. Clark El Paso, Tx 79905 PH: 800-648-9013 FAX: 888-779-3065 BEB PAGE: HTTP://www.nilandco.com